

Micro-perforated duct for HVAC & SEFFC

DESCRIPTION:

In this data sheet there is an example of MICRO FIRE's application in a shopping centre with air treatment machines with ducts.

The requirement is to have a single duct, due to layout constraints, for both HVAC systems (Air Treatment - Heating/Cooling) and for use in case of smoke extraction - UNI 9494-2 (free smoke layer 2,50 m)

QUICK SIZING:

- 21.000 m³/h required airflow for HVAC
- 45.000 m³/h airflow for SEFFC smoke extraction

QUICK SELECTION FOR AIR TREATMENT:

- Double throw: approx. 240-260 m³ per linear meter
- Single throw: approx. 120-130 m³ per linear meter



Diametro	PORTATA Max. Trattamento HVAC	PORTATA Max. Estrazione Fumi
mm	m ³ /h	m ³ /h
350	1.100 - 1.471	2.596 - 3.635
400	1.582 - 1.922	3.391 - 4.748
450	2.000 - 2.432	4.292 - 6.009
500	2.472 - 3.003	5.299 - 7.418
550	3.000 - 3.633	6.411 - 8.976
600	3.560 - 4.324	7.630 - 10.682
650	4.180 - 5.074	8.955 - 12.537
700	4.847 - 5.885	10.386 - 14.540
750	5.560 - 6.756	11.922 - 16.691
800	6.330 - 7.687	13.565 - 18.991
850	7.150 - 8.678	15.313 - 21.439
900	8.000 - 9.729	17.168 - 24.035
950	9.000 - 10.839	19.128 - 26.780
1000	9.890 - 12.011	21.195 - 29.673

Select n.6 micro-perforated ducts with an airflow capacity of 3.000 m³/h (HVAC) and 7.500 m³/h (Smoke extraction).

Micro-perforated duct for HVAC & SEFFC


SIZING OF THE MICRO-PERFORATED DUCT FOR HVAC:

Air distribution in the environment is more uniform compared to traditional systems with diffusers or grilles. Moreover, by drastically reducing stratification, the system's startup and operating times are significantly decreased. The diffusers do not require insulation.

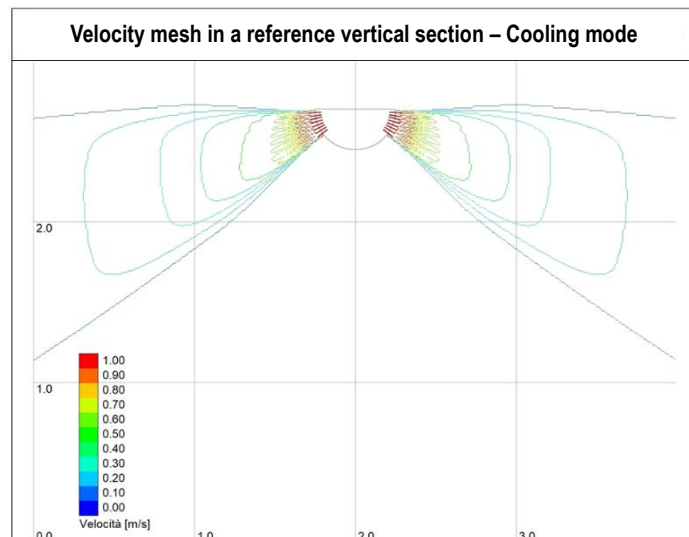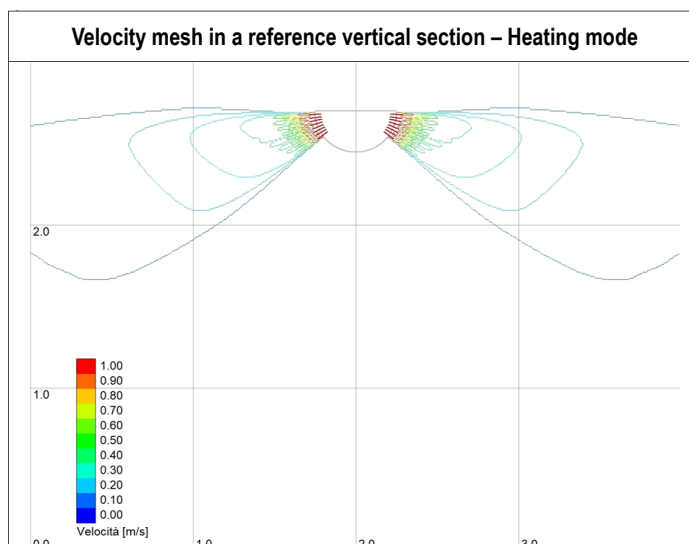

Micro-perforated duct for HVAC & SEFFC

TECHNICAL DRAWING - HVAC

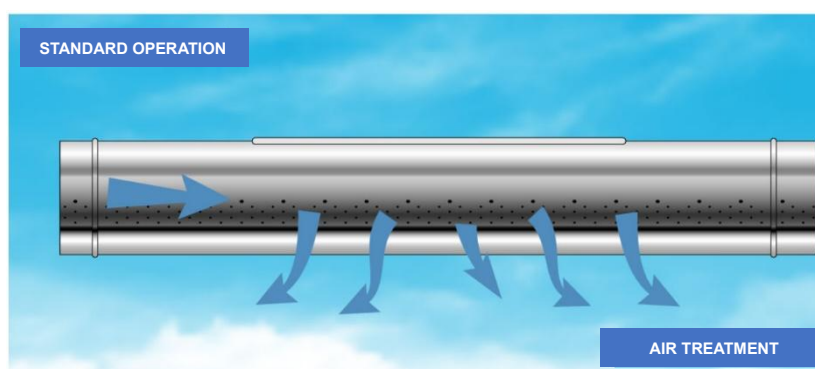

Micro-perforated duct for HVAC & SEFFC

TECHNICAL DRAWING - SMOKE EXTRACTION

